
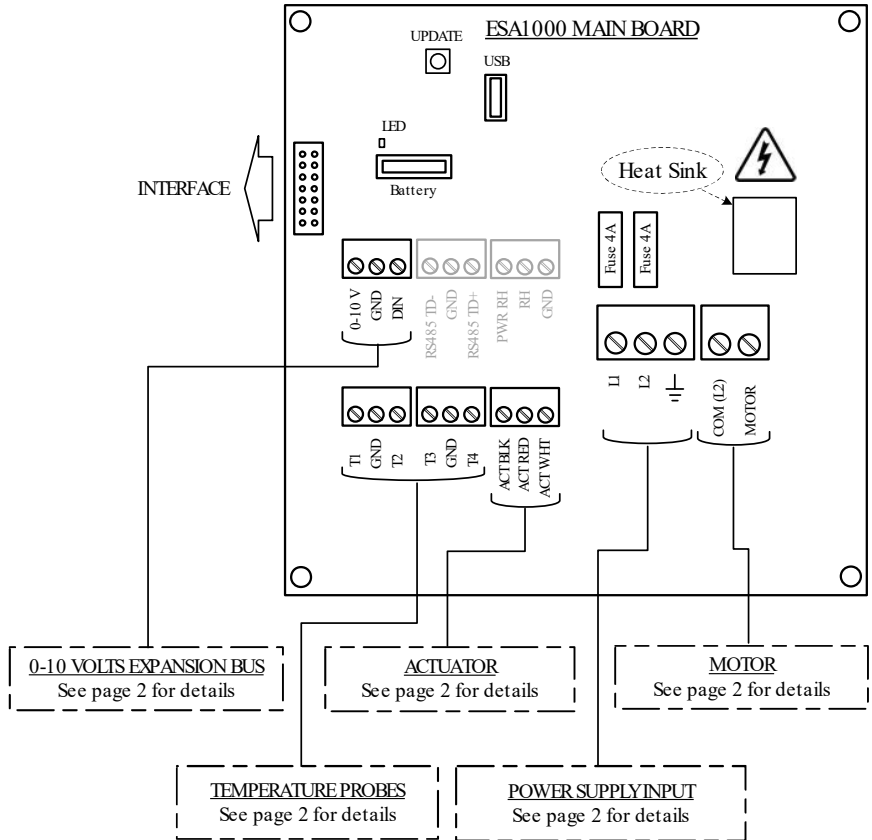


FIGURE 2: WIRING DIAGRAM

 The electrical load distribution must be determined by a qualified electrician and installed as prescribed by the applicable regulations of the electrical code.



Note 1 : L1 & L2 need to be powered to turn the unit ON.

Note 2 : The zone around the Heat Sink is exposed to the electrical network and must not be touched due to RISKS OF ELECTROCUTION as indicated by the symbol printed on the board.



MULTIPLE UNITS INTERCONNECTION

